




ANSI Highlights

Cod. **1200/680-D1**

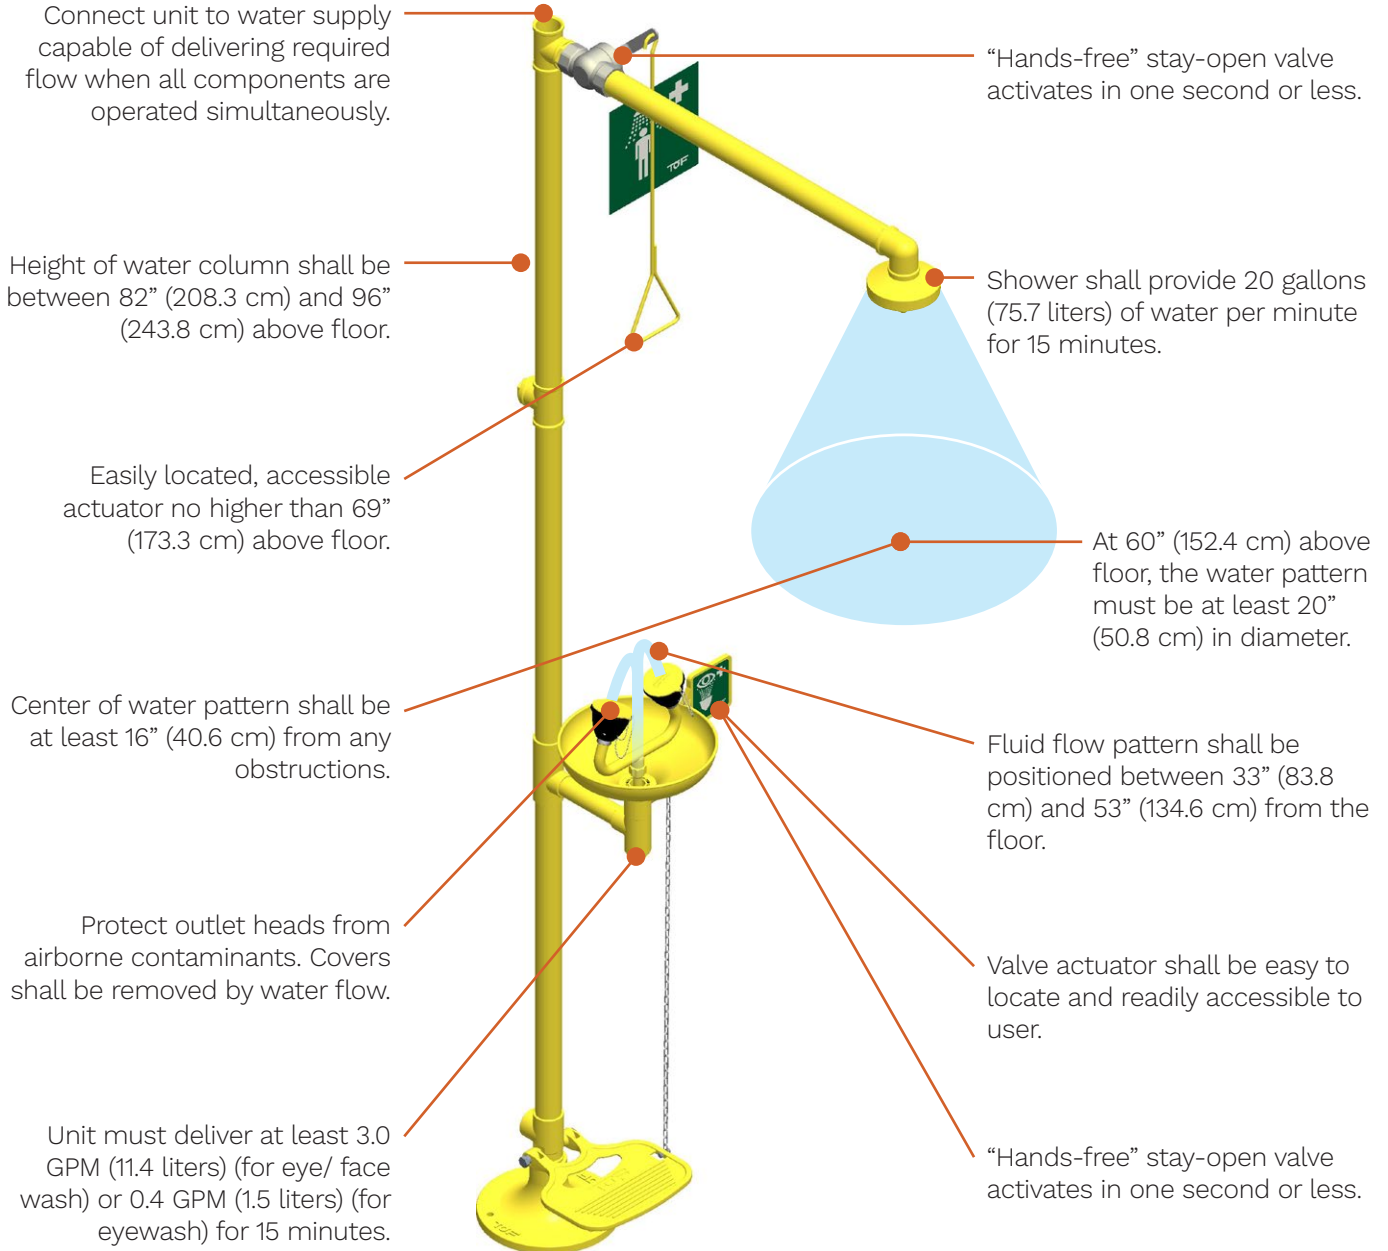

LOCATION

Install safety station within 10 seconds (approximately 55 feet) of hazard, on the same level as hazard and with unobstructed travel path.

IDENTIFICATION

Identify safety station with highly visible sign. Area around safety station shall be well-lit.

WATER TEMPERATURE

Water delivered by safety station shall be tepid (60-100°F).

TRAINING

Instruct all employees in the location and proper use of safety station.

MAINTENANCE/ INSPECTION

Activate safety station at least weekly. Inspect annually for compliance with standard.